


INSTALLATION INSTRUCTIONS

❖ J-Box Mounting


1. Feed fixture leads through main bottom case and connect AC power supply (Fig A).
2. Connect wires through J-Box .Place bottom case on J-Box and secure with screws.
3. Connect battery only when continuous AC power can be provided to the unit(Fig B) .
4. Align snaps and push housing directly onto main bottom case (Fig C) apply continuous AC power and press "TEST" button to check lamps.

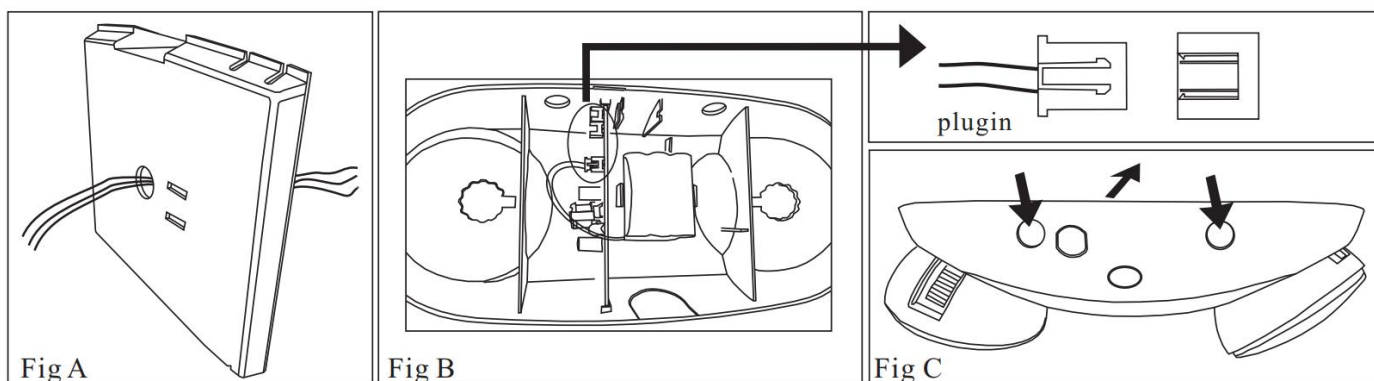


❖ Conduit

1. During an electrical power failure, the lamps will automatically come on for a minimum of 90 minutes.
2. To test ,press the “TEST” switch , the emergency lamps will illuminate. When the switch is released ,the lamp will go off.

❖ WIRING DIAGRAM

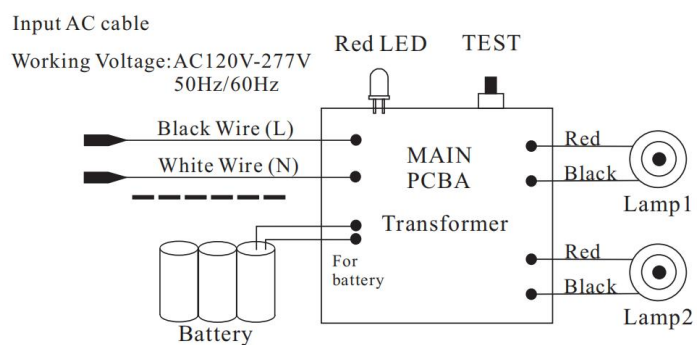

❖ ADJUST LAMP HEADS AND LENS

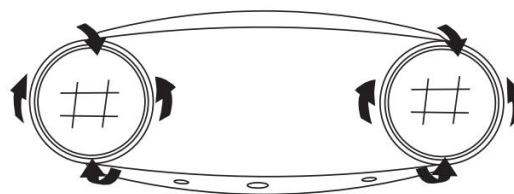

Only narrow lens has adjustable function.
Adjust lamp heads and lens direction according
your needs.